
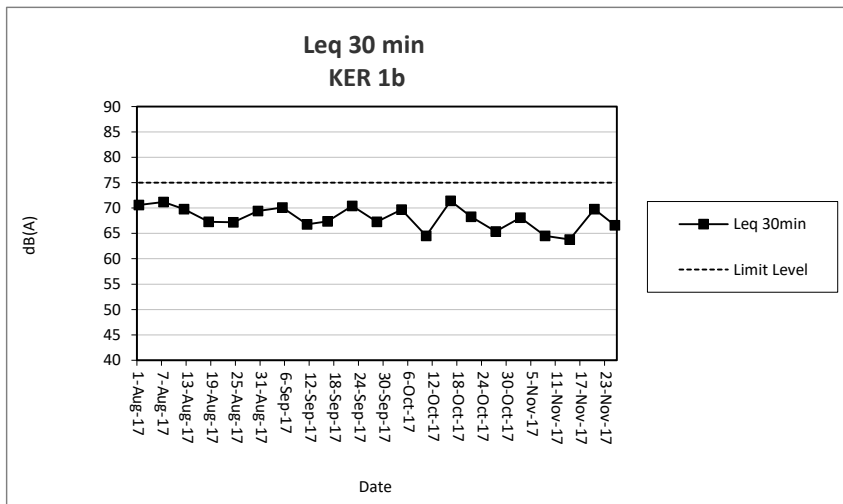
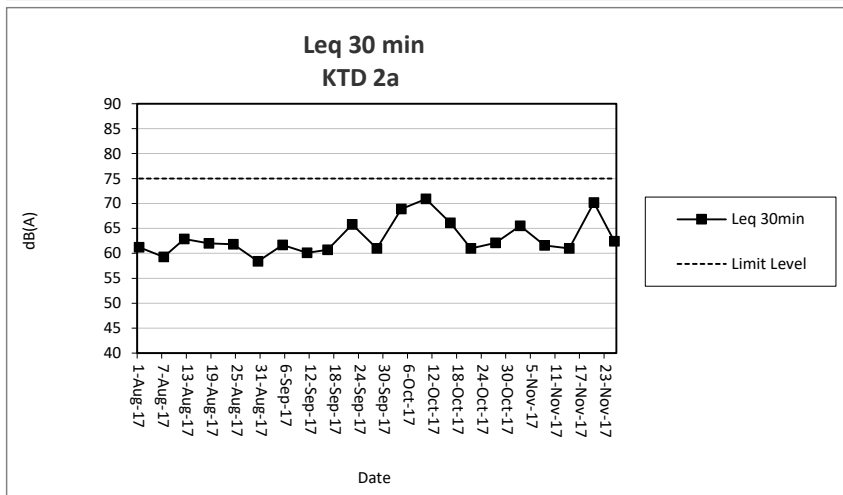


Note:

- 1) The major activities being carried out on site during the reporting period can be referred to Section 1.3.1.
- 2) The weather conditions during monitoring in the reporting period was range from cloudy, fine and sunny.
- 3) Any other factors which might affect the monitoing results can be referred to Section 2.3.4.

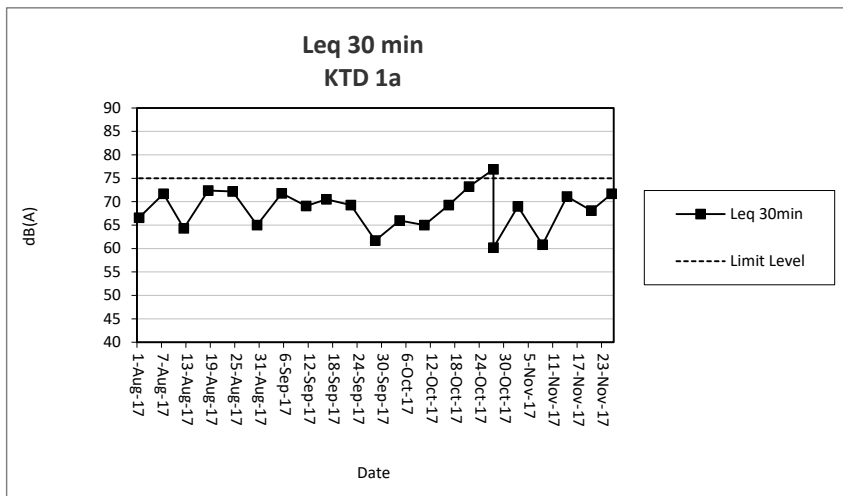

**Note:**

- 1) The major activities being carried out on site during the reporting period can be referred to Section 1.3.1.
- 2) The weather conditions during the reporting period can be referred to Appendix K.
- 3) Any other factors which might affect the monitoring results can be referred to Section 3.7.2.
- 4) QA/QC results, calibration results and detection limits can be referred to Appendix D.
- 5) For the monitoring location KTD 1a, the measured noise level (77 dB(A)) on 27<sup>th</sup> October 2017 exceeded the limit level. Piling noise from the Children Hospital was observed by our staff during noise monitoring. Repeat measurement was conducted to confirm the finding and the measured noise level (60 dB(A)) was below the limit level. Only vehicle noise along Shing Fung Road was observed in the second noise monitoring.